


Existing Construction

Permanent Reinstatement

Notes:

1. The subbase to be put back shall be of granular material and shall be of the same thickness of the adjoining footway subject to a minimum of 75mm.
2. The concrete slab to be put back shall be of Grade 30/20 concrete and shall be of the same thickness of the adjoining footway subject to a minimum of 75mm.
3. Refer to Drg. No. H1128 for limit of reinstatement.

## CONCRETE FOOTWAY

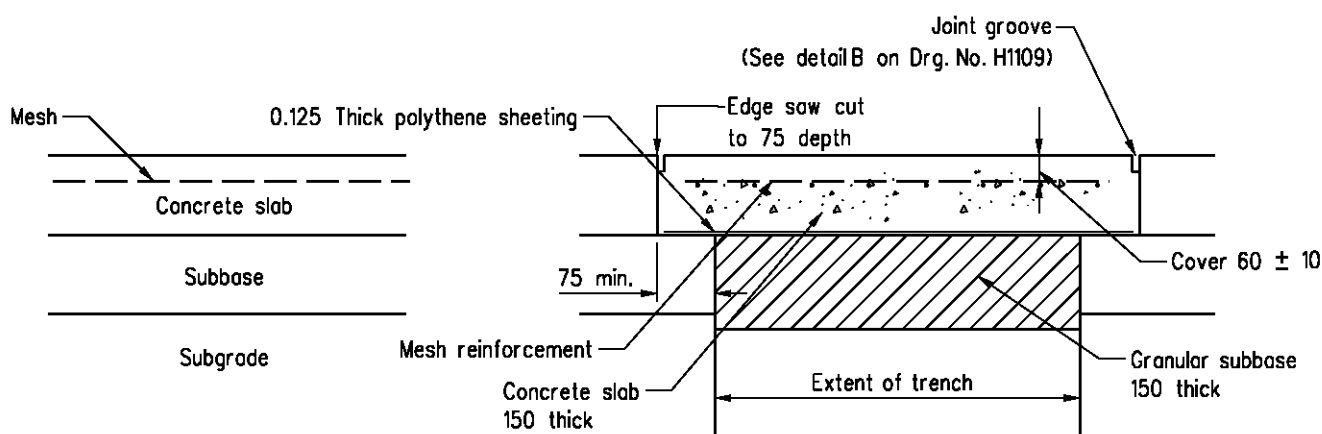

Existing Construction

Permanent Reinstatement

Notes:

1. The subbase to be put back shall be of granular material and shall be 150 millimetres thick.
2. The concrete slab to be put back shall be of Grade 40/20 and shall be 150 millimetres thick.
3. Mesh reinforcement shall be C283 long mesh and shall be laid with the main bars parallel to the longer dimension of the reinstatement area.
4. Refer to Drg. No. H1128 for limit of reinstatement.
5. All dimensions are in millimetres.

## CONCRETE RUN-IN

B	Joint groove details revised		Nov 96
A	Grade of concrete for footway revised		Sept 96
	Former Drg. No. H1018/5 with general revision		June 94
REF.	REVISION	SIGNATURE	DATE

PERMANENT REINSTATEMENT  
OF PAVEMENT –  
CONCRETE FOOTWAY AND RUN-IN  
(SHEET 1 OF 2)

HIGHWAYS DEPARTMENT

REFERENCE

DRAWING No.

CAD

SCALE

N.T.S.

H 1127B