



SEC. A - A STAGE I

Collapsible sealing groove former (for expansion joint only)

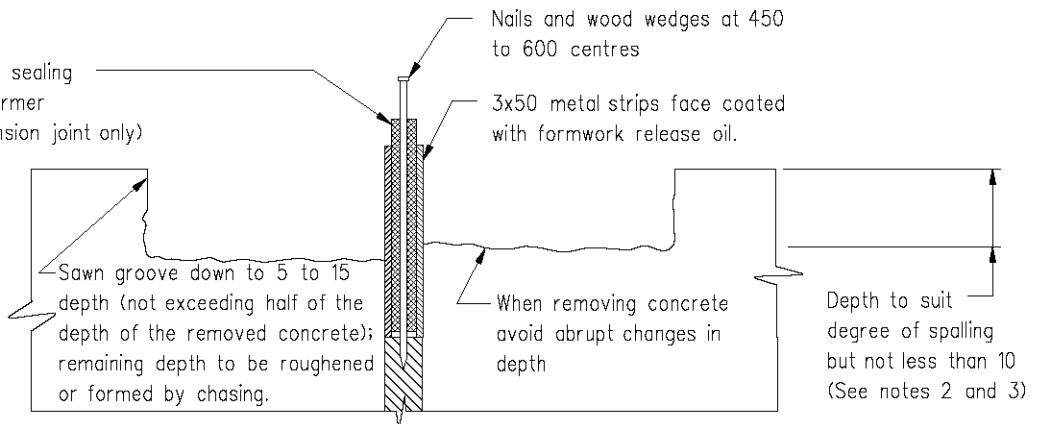


SEC. A - A STAGE II

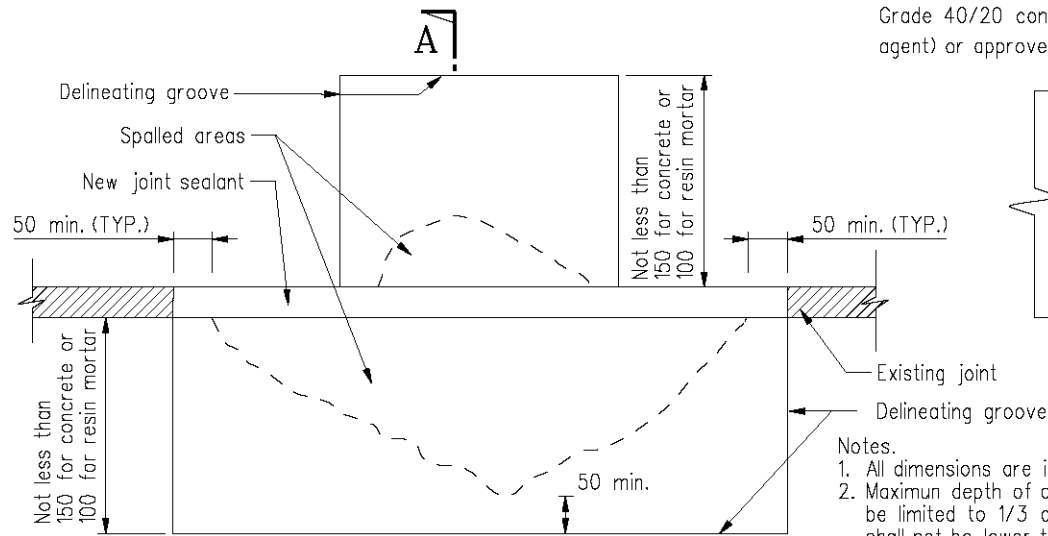

SHAPE OF REPAIR IN PLAN

Grade 40/20 concrete (with bonding agent) or approved resin mortar

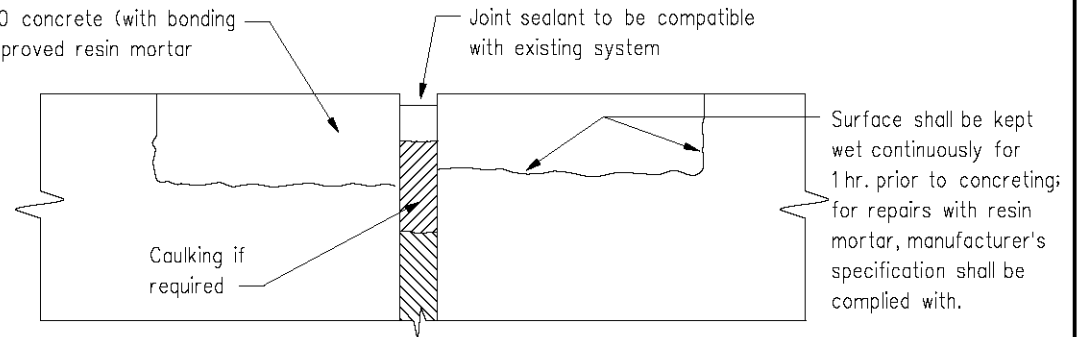

SEC. A - A STAGE III

Notes.

1. All dimensions are in millimetres
2. Maximum depth of concrete to be removed shall be limited to 1/3 of concrete slab thickness and shall not be lower than the top of the dowel bar.
3. Refer to Drg. No. H1122 for depth of concrete to be removed lower than the top of the dowel bar or larger than 1/3 of concrete slab thickness, whichever is the less.

| | | | |
|------|--|-----------|---------|
| A | Drg. title amended; descriptions generally revised and notes 2 & 3 added | | Nov 12 |
| | Former Drg. No. H1008/2 with general revision | | June 94 |
| REF. | REVISION | SIGNATURE | DATE |

TRANSVERSE JOINT REPAIR

HIGHWAYS DEPARTMENT

REFERENCE

DRAWING No.

CAD

SCALE

Diagrammatic

H 1121A