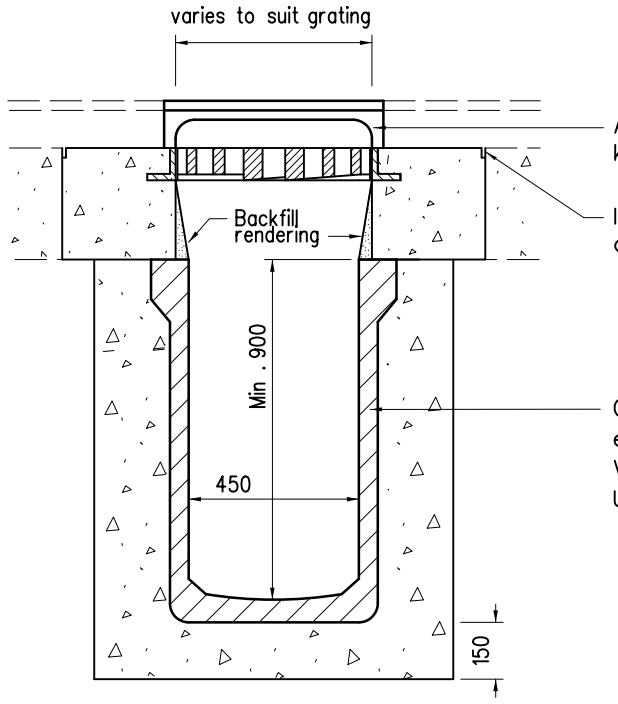

SECTION A-A

Note :

1. Trapped gullies are only necessary if stormwater carrier drain is likely to be contaminated by sewage e.g. when carrier drain is a combined drain
2. Plug chain shall be min. 3mm stainless steel (S.S.), securely fixed to the plug and wall by S.S. anchor.

Gully former to approved design,
e.g. Precast conc. (BS 5911-6)
Vitrified clay (BS EN 295)
UPVC or other approved plastic material

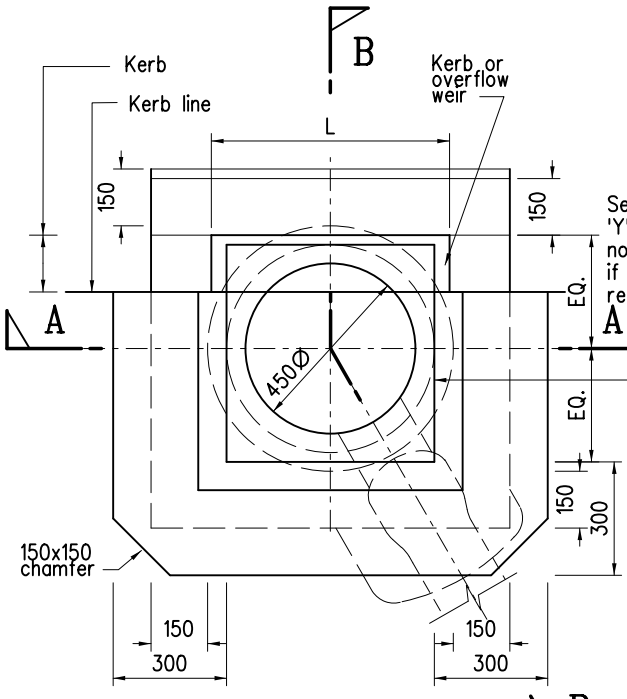

PLAN

(Only outlines of weir and grating are shown for clarity)

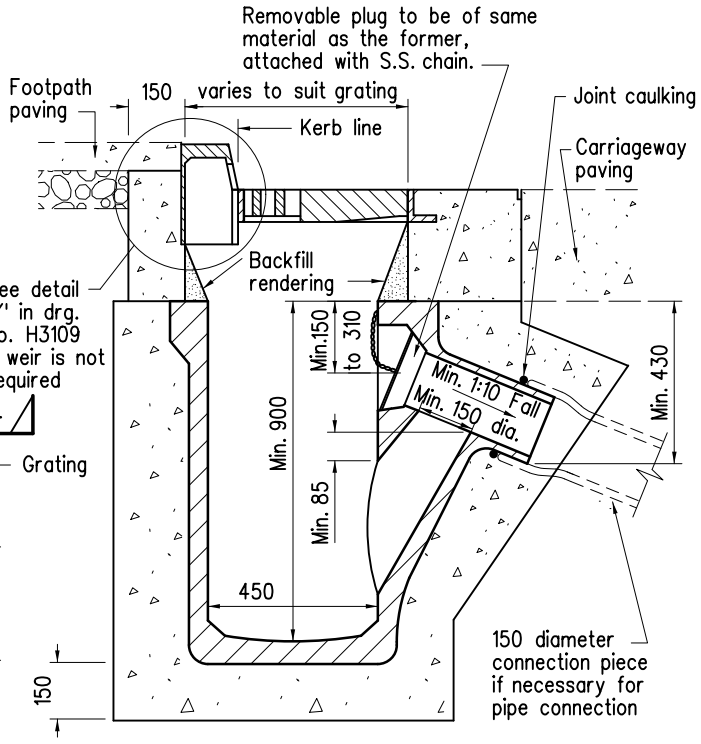

SECTION B-B

REF.	REVISION	SIGNATURE	DATE
B	Update on reference standard on the gully former approved design	Original Signed	Sep 25
A	Trapped outlet details revised, plug chain specified.	-	Mar 11
	Former drg. no H3006 with general revision	-	June 94

TRAPPED GULLY WITH GULLY FORMER

HIGHWAYS DEPARTMENT

REFERENCE	DRAWING No.	CAD
SCALE 1 : 20	H 3110B	