


NOTES:

1. EARTHING SHALL BE CARRIED OUT IN ACCORDANCE WITH BS7671 AND THE LATEST EDITION OF I.E.E. REGULATIONS AND THE CODE OF PRACTICE FOR THE ELECTRICITY (WIRING) REGULATIONS.
2. THE WIRING DIAGRAM SHOWING ALL CIRCUITS CONNECTIONS MUST BE ATTACHED TO THE CONTROL CUBICLE AND REGULARLY UPDATED.

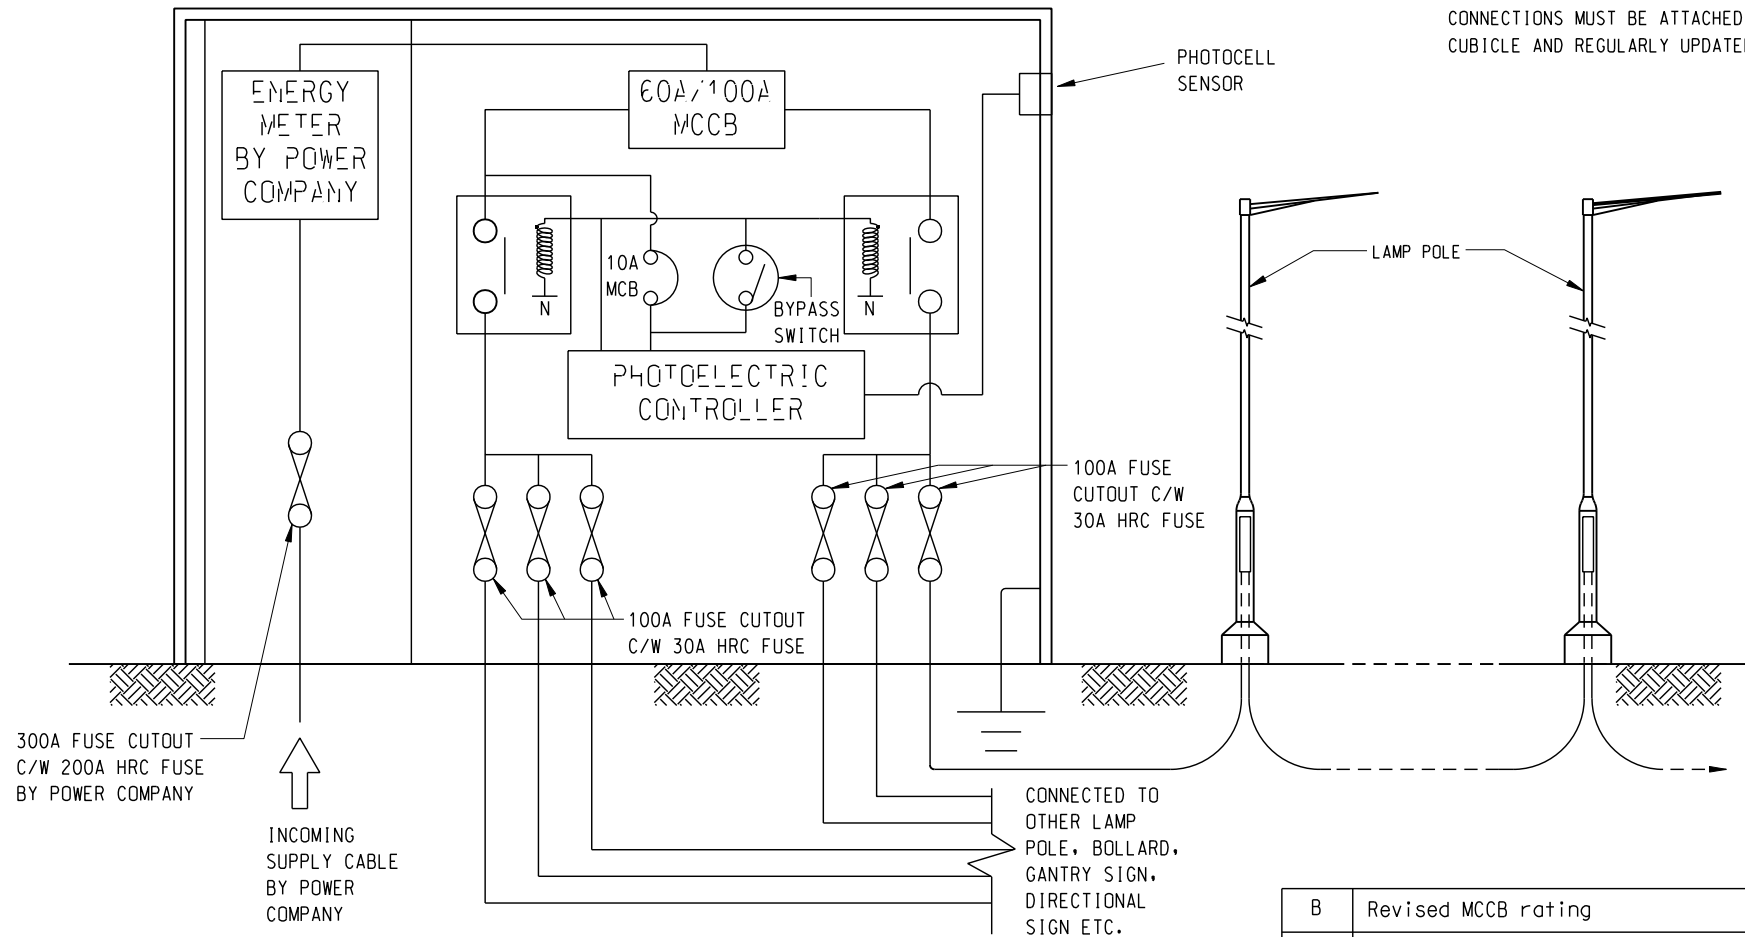

PUBLIC LIGHTING CONTROL CUBICLE

B	Revised MCCB rating		Jun 10
A	General Revision		Mar 07
	Former Drg. No. HLDSGE01-CL0010C with general revision		Feb 06
REF.	REVISION	SIGNATURE	DATE

TYPICAL SCHEMATIC WIRING DIAGRAM FOR PUBLIC LIGHTING CONTROL CUBICLE

HIGHWAYS DEPARTMENT LIGHTING DIVISION

REFERENCE	DRAWING No.	CAD
SCALE	HLDSML06-CL1018B	
N.T.S.		