

Attachment 12
Photos of Services of Towngas Telecom




PVC Duct : Diameter 50-107mm)




PVC Bend Duct : Diameter 56-107mm)



Joint Box – Recess Type)

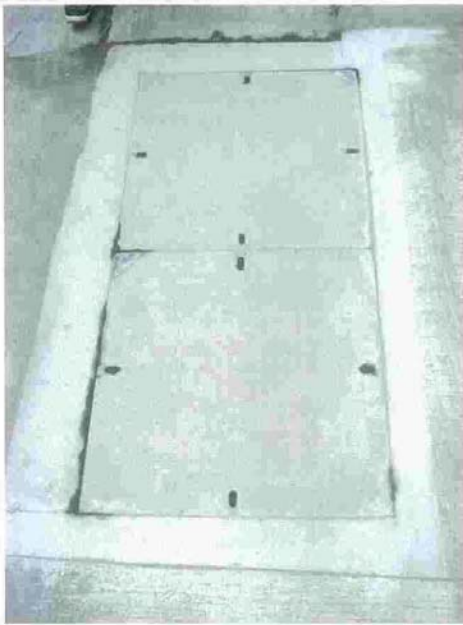


Joint Box – Concrete Type)

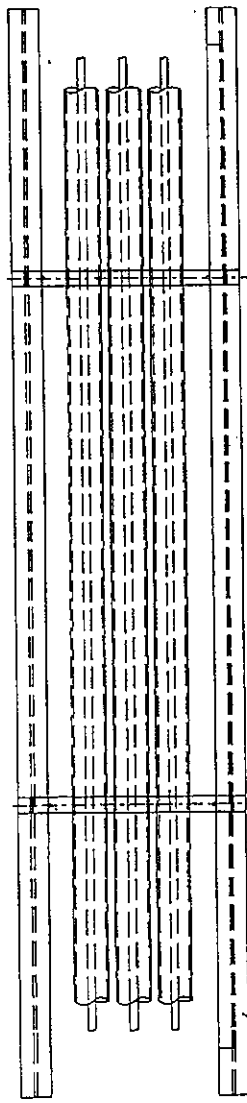


WOODEN FRAME

PLAN

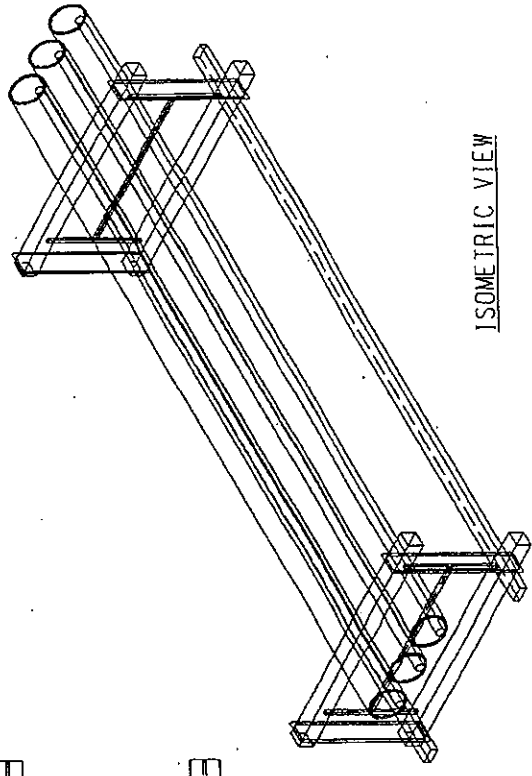


ISOMETRIC VIEW

STEEL CROSS BEAM

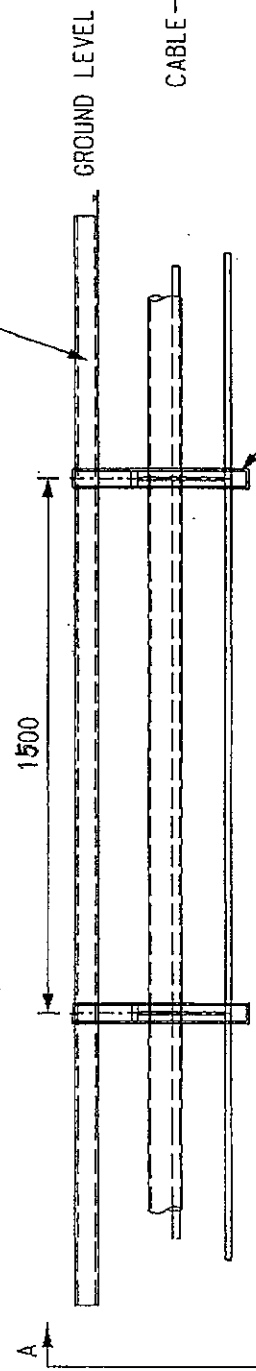


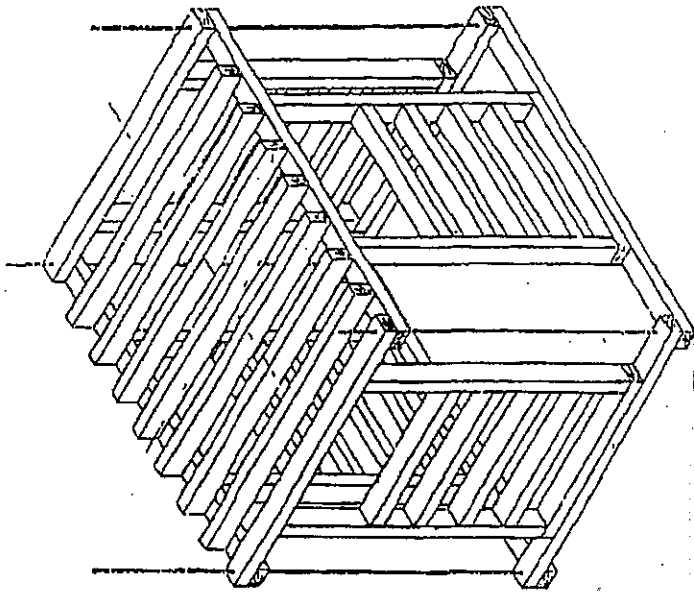
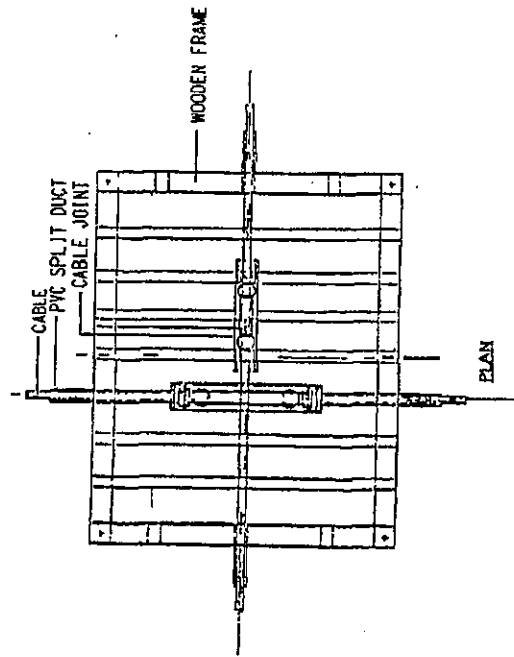
END VIEW

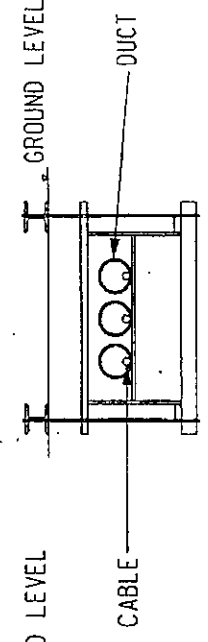



SECTION A - A

ALL DIMENSIONS IN mm

	Project: TYPICAL METHOD OF SUPPORTING DUCT WITH CABLES	Scale: N.T.S.	Drawing No.: EST-083
---	---	------------------	-------------------------



ISOMETRIC VIEW
(DUCT CABLE & CABLE JOINT NOT SHOWN FOR CLARITY)

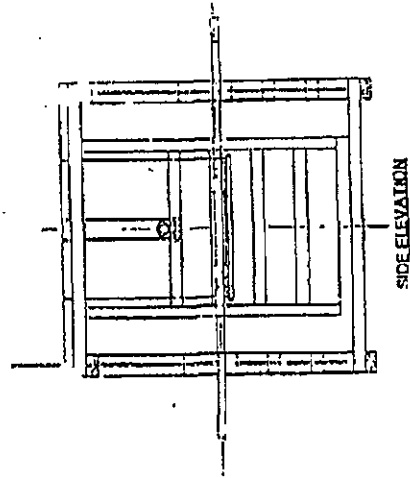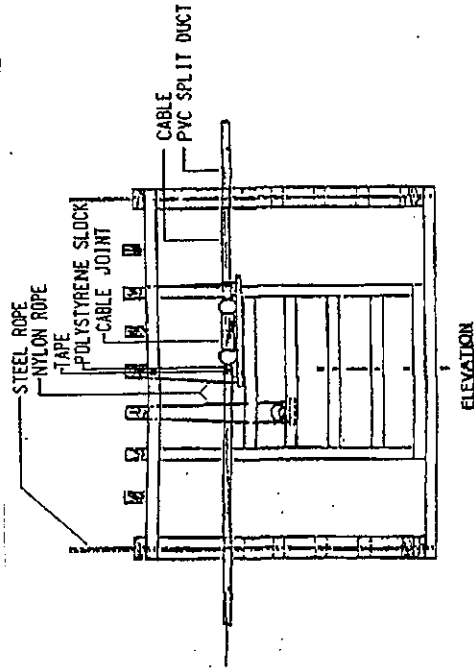


NOTE:
THE SIZE OF THE CABLE SUPPORTING FRAME
WILL BE DETERMINED ON SITE


ALL DIMENSIONS IN mm

Project:

Drawing No.:

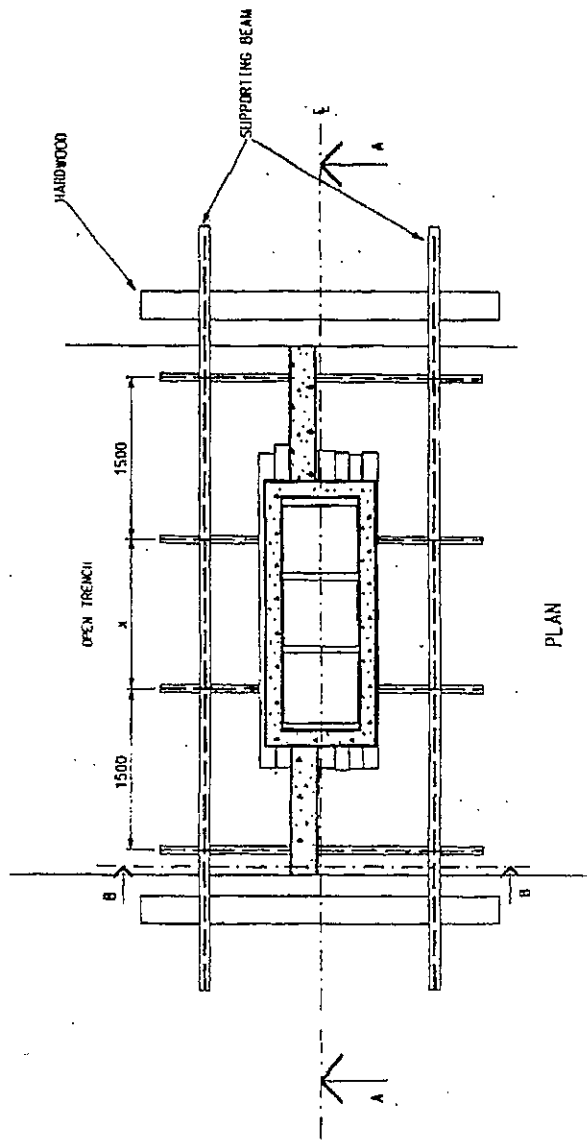

DISTANCE OF X	
JBF 1	600mm
JBF 2	1000mm
JBF 3	1500mm

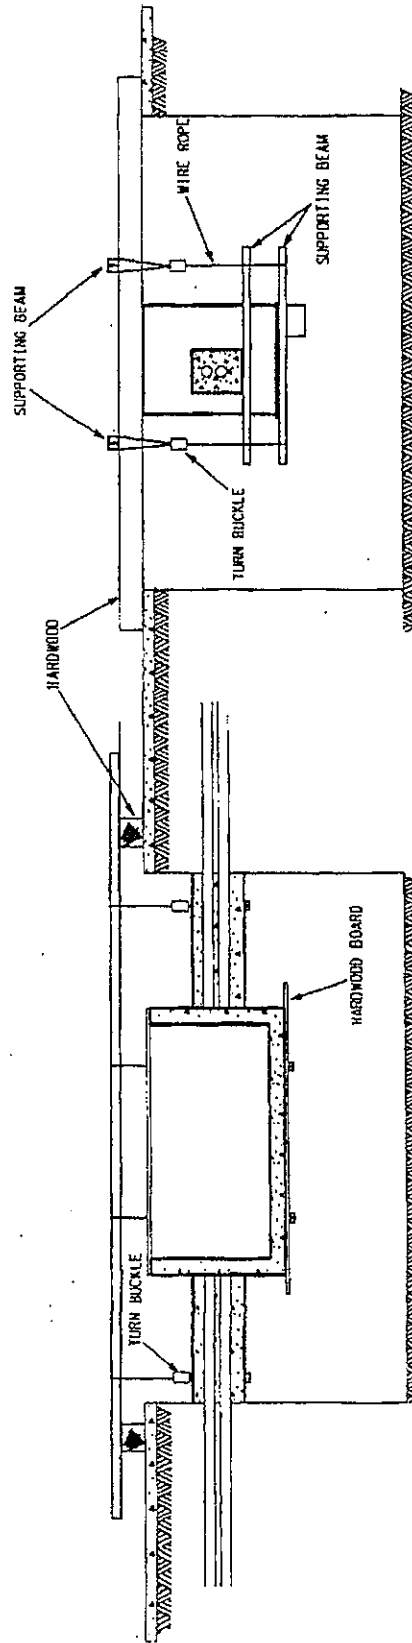

SECTION A-A

SECTION B-B

ALL DIMENSIONS IN mm